



## DEVELOPMENT REVIEW COMMITTEE (DRC) COMMENT REPORT

**MEETING DATE:** February 12, 2019

**APPLICANT:** City of Fort Lauderdale

**PROJECT NAME:** Sano Jet Center

**CASE NUMBER:** R19009

**REQUEST:** Site Plan Level II Review: 20,000 Square Foot  
Aircraft Hangar

**LOCATION:** 1525 NW 56th Street

**ZONING:** General Aviation Airport (GAA)

**LAND USE:** Transportation

**CASE PLANNER:** Tyler Laforme



**Case Number: R19009**

**CASE COMMENTS:**

- 1) Provide the FBC Building Type designation on the plans.
- 2) Indicate FBC compliant occupant Loads.

**GENERAL COMMENTS**

The following comments are for informational purposes.

Please consider the following prior to submittal for Final DRC:

1. The Florida Building Code shall apply to the construction, alteration, movement, enlargement, replacement, repair, equipment, use and occupancy, location, maintenance, removal and demolition of every building or structure or any appurtenances connected or attached to such buildings or structures.
2. All projects must consider safeguards during the construction process. Florida Building Code Chapter 33 delineates various safeguards that may apply during the construction phase. All structures associated with the protection of pedestrians will require a separate permit. A licensed professional must sign and seal the plans and specifications.
3. The City of Fort Lauderdale is a participating municipality in the National Flood Insurance Program (NFIP). The requirements specific to the City of Fort Lauderdale can be found in

**Chapter 14 - FLOODPLAIN MANAGEMENT of the Code of Ordinances** and accessed at;

- a. [https://www.municode.com/library/fl/fort\\_lauderdale/codes/code\\_of\\_ordinances?nodeId=COOR\\_CH14FLMA](https://www.municode.com/library/fl/fort_lauderdale/codes/code_of_ordinances?nodeId=COOR_CH14FLMA)

**Please consider the following prior to submittal for Building Permit:**

1. On January 1<sup>st</sup>, 2018 the 6<sup>th</sup> Edition of the Florida Building Code was adopted. All work described in Section 101.2, of the Broward County Administrative portion of the Florida Building Code, will govern the administration and enforcement of the proposed work. Each building and or structure will require a separate permit. The following websites will assist in the design considerations:
  - a. <http://www.fortlauderdale.gov/departments/sustainable-development/building-services>
  - b. [https://floridabuilding.org/bc/bc\\_default.aspx](https://floridabuilding.org/bc/bc_default.aspx)
  - c. <http://www.broward.org/codeappeals/pages/default.aspx>

**General Guidelines Checklist is available upon request.**



Case Number: R19009

**CASE COMMENTS:**

Prior to final DRC sign-off, please provide updated plans and written response to the following review comments:

1. Meet the City's Adequacy requirements to services provided to the public (fire service, water, wastewater, stormwater, transportation, etc.), per ULDR Section 47-25.2 of the City's Code of Ordinances. Assess potential demands and impacts on City services and prepare a design for each that utilizes existing water, wastewater, stormwater, and transportation infrastructure to adequately serve this project. If the adequate infrastructure is not available, prepare a design that extends/expands the connection to the nearest City system to adequately serve this development.
2. Provide a current signed and sealed boundary and topographic survey showing all above ground improvements, utilities, rights of way dimensions and all easements. This survey shall be based on a Standard Title Commitment issued by a title insurer licensed to do business in Florida or an Opinion of Title issued by an attorney admitted to the Florida Bar. The title commitment or Opinion of Title must have an effective date no more than thirty days prior to the date of submittal of the survey and must be certified to the City of Fort Lauderdale. If any encumbrances are found in the property, provide a copy of the recorded documents accordingly (i.e. easements, dedications, agreements, vacations, etc.).

Property lines, NVAL, Right-of-Way, watercourses, easements, structures, and roadway shall be clearly shown, labeled and dimensioned. Provide spot elevations on site, at property corners, along property lines (50' min. interval), existing roadway crowns and pavement edges adjacent to property as appropriate. Elevations shall be referenced to the North American Vertical Datum of 1988 (NAVD 88).

3. Submit a formal Site Plan that features all critical dimensions for the proposed development, such as building setbacks, parking lot access, driveway widths, sidewalk dimensions, etc. Clearly indicate limits of construction/ improvements being reviewed/ approved as part of this site plan.
4. Clarify proposed traffic circulation as it appears the spaces between hangars F and G are being used as storage for airplanes. Is existing chainlink fence being removed?
5. Label on Site Plan Data Table the required and proposed type of loading zone(s) required, per ULDR Section 47-20.2 Table 2 and Section 47-20.6; also label location of ADA van-accessible parking stalls. If applicable, show truck turning template circulation (label typical minimum centerline turning radius) entering and exiting the site as required for the proposed development. Turning geometries and loading zone design shall be in accordance with ULDR Section 47-20.6.
6. For surface parking lot layout:
  - a. Show and label total number of parking stalls, dimension areas including drive aisle widths, and typical parking stall width/depth.
  - b. Per ULDR Section 47-20.11.A, drive aisle width shall be 24' (min.) adjacent to 90-degree angle parking stalls, 18' (min.) adjacent to 60-degree angled parking stalls, 13' (min.) adjacent to 45-degree angled parking stalls, and 12' (min.) adjacent to 30-degree angled parking stalls. Label on plan the proposed angled parking to confirm 45 degree is proposed.
7. Coordinate with Public Works for any connections to and/or demolition of existing City infrastructure. Any new trees (located within or adjacent to City Right-of-Way) should be placed with sufficient horizontal and vertical distances (per City, County, and State guidelines) to/from City's public infrastructure, including stormwater assets, to allow for continued Public Works maintenance without



- obstruction. If this cannot be accommodated due to field conditions, then the developer shall relocate the existing City's public infrastructure to resolve the conflict(s) and to comply with City's, County's & State's engineering standards/permits/policies.
- a. For Storm Drainage, Sanitary Sewer, and Water related matters, contact Raymond Rammo at 954-828-5990 or [rammo@fortlauderdale.gov](mailto:rammo@fortlauderdale.gov).
  - b. For City Utility Atlas Maps, GIS, and as-built information, to help accurately plot and label utilities in the vicinity of proposed work, contact Craig Barrett at 954-828-5875 or [crbarrett@fortlauderdale.gov](mailto:crbarrett@fortlauderdale.gov).
  - c. Provide written correspondence between Public Works and the Engineer of Record.
8. Show and label all existing and proposed utilities (utility type, material and size) on civil and landscaping plans for potential conflict. A min. 5 feet and 10 feet horizontal clearance is required between the edge of City utilities infrastructure (pipes, exfiltration trenches, structures, etc.) and proposed small and large trees, respectively (including proposed water and sewer services to the development). Appropriate root barriers shall be installed per City's landscaping regulations a min. 1 foot away from the City utility/ infrastructure. Any new trees (located within or adjacent to City Right-of-Way) should be placed with sufficient horizontal and vertical distances (per City, County, and State guidelines) to / from City's public infrastructure, including stormwater assets, to allow for continued Public Works maintenance without obstruction. If this cannot be accommodated due to field conditions, then the developer shall relocate the existing City's public infrastructure to resolve the conflict(s) and to comply with City's, County's & State's engineering standards/permits/policies. Demonstrate separation is provided and include a note regarding horizontal clearance requirement on the landscape plans.
9. Prepare service demand calculations for water & wastewater services and obtain a letter of service availability from the City's Public Works – Engineering Department. Submit water and wastewater capacity availability request form and documents/ plans at <https://www.fortlauderdale.gov/departments/sustainable-development/building-services/engineering-forms-and-info/development-review-committee-service-demand-calculations-for-water-se>
10. Conceptual Paving, Grading and Drainage Plans and Typical Section:
  - a. Verify proposed berm slopes, max. 4:1 slopes are "recommended" for maintenance purposes.
11. Provide storm runoff calculations, signed and sealed by a Florida registered professional engineer, which demonstrate how minimum criteria regarding adjacent street crown, water quality and finished floor elevations are met, as well as how the 25-year, 3-day storm event is maintained on site with zero discharge to Right-of-Way and adjacent properties (Pre vs. Post analysis will only be allowed in areas that are not flood-prone). Please also comply with the City of Fort Lauderdale Comprehensive Plan (Ordinance C-08-18), Objective 4.1 under Infrastructure Elements, and be advised that effective 7/1/2017, all projects must comply with the Broward County 'Future Conditions Average Wet Season Groundwater Level' map. Conduct geotechnical tests to render the K value (Hydraulic Conductivity) used in the exfiltration design calculations.
12. Evaluate the possibility of utilizing a sustainable stormwater approach with the possibility of low impact (cisterns, pervious pavers, bioswales, raingardens, etc.) uses for landscaping along the streetscape.
13. Please provide (or revise if already submitted) an erosion, sedimentation, and stormwater pollution prevention plan (**SWPPP**) showing the adjacent City's existing stormwater system. A copy of the approved SWPP shall be at the construction site from the date of demolition initiation to the date of final construction activities.



Add the following notes to the **SWPPP** (CCTV Notes, Pollution Prevention Notes, and Dewatering Notes):

Closed Circuit TV inspection (CCTV) Notes

- a) Contractor shall provide CCTV videotapes to City STW OPS of the existing stormwater system to the limits shown with green line work in the storm map provided at the end of this report in order to document the PRE and POST construction conditions of the City's storm system.
- b) Contractor shall provide the PRE construction CCTV to City STW OPS when applying for a demolition permit at the City's building department.
  - I. If debris is found in the City's stormwater system prior to demolition or construction, the applicant, contractor, developer or designer (as applicable) shall inform the City's stormwater operations department for proper removal.
- c) Contractor shall provide the POST construction videotape to City STW OPS when requesting the Certificate of Occupancy (CO) to verify that the City's stormwater systems have not been negatively impacted by the demolition and construction activities.
  - I. If debris is found in the City's storm systems as a result of demolition or construction activities, it will be the responsibility of the contractor to vacuum clean the City's stormwater system (or make repairs as requested by City's stormwater operations group) prior to issuance of final CO.
  - II. If surface water runoff or debris from demolition or construction activities is found to have negatively impacted the condition of the City's stormwater assets, it will be the responsibility of the applicant (contractor, developer, and owner) to rectify the infraction(s) as requested by City.

Pollution Prevention Notes (Applicable to most site developments)

- a) Contractor shall adhere to of the National Pollution Discharge Elimination System (NPDES) requirements. The contractor shall institute Best Management Practices (BMPs) to ensure compliance with the NPDES program and to minimize the impact to public stormwater facilities. A Notice of Intent (NOI) shall be filed prior to start construction activities.
- b) Prior to demolition activities, contractor shall install pollution prevention control devices (i.e., silt barriers, sediment basins, turbidity barriers around stormwater outfalls on the waterside of lakes, ponds, canals, or waterways, silt screens, etc. according to the approved SWPPP and as recommended by the Florida Department of Environmental Protection (DEP) latest guidelines and permitting requirements.
- c) Prior to demolition activities, a silt fence in accordance with the approved SWPPP details and latest DEP standards shall be erected around the site property lines. All public inlets surrounding the site shall be protected by the installation of filter fabric into the frame and grate or other approved BMPs to protect against storm runoff.
- d) Pollution control installations, as approved and shown in the SWPPP, shall be maintained throughout demolition and construction periods until the project has been completed and approved by City engineering inspector or project engineer.
- e) Contractor shall inspect the pollution control devices daily for signs of malfunction, failure, or needed repairs, and shall make remedial actions immediately upon discovery.
- f) Existing stormwater inlets, catch basins, or manholes, onsite and offsite, shall be protected from sediment storm runoff from the proposed demolitions and construction activities.
- g) Contractor shall immediately remove all mud, dirt, or other materials tracked or spilled onto existing roads and facilities due to demolition or construction activities from the proposed development.
- h) In order to minimize the amount of sediments, mud, and dust transported onto public roadways by the construction vehicles or runoff, the contractor shall install stabilized temporary construction entrance(s) from the construction site as recommended by FDEP. Each temporal construction entrance is a stabilized 6-inch thick layer of 2 to 3 inch Course





Aggregate Stone, 12" minimum width, and length to accommodate a minimum of one trucking vehicle.

- i. The entrance shall be maintained periodically as conditions demand in a condition that will prevent tracking or flowing of sediments onto public rights-of-way. Sediment shall be trapped in cleanout areas and properly handled as onsite debris per applicable state regulations.
  - ii. When necessary, vehicle wheels shall be cleaned prior to entrance onto public right-of-way.
  - iii. All materials spilled, dropped, washed or tracked from vehicles onto roadways or into public storm drains must be removed by the contractor immediately.
  - iv. Trucks shall not 'cut corners' where the construction exit meets the roadways.
  - v. Sweeping of public roadways shall be done periodically as condition demand.
- i) Dust generated from construction shall be minimized by daily watering of the site.
  - j) Contractor shall provide an erosion and sedimentation control inspector to inspect all points of discharge into nearby waterbodies to record the condition of discharge points, integrity of silt fence and pollution control devices, dust control measures, vehicular traffic and construction material storage and disposal. Written record of all inspections shall be stored by the contractor during demolition and construction periods and shall be submitted to City inspectors upon request.

The inspection report shall include at a minimum the following information:

- i. Name of inspector and his/her qualifications in erosion and sedimentation control
- ii. Date of the inspection
- iii. Rainfall rate
- iv. Observations about the SWPP
- v. Actions taken by contractor for all incidents of noncompliance with permit(s)
- vi. Certification that the facility is in compliance with the SWPP and permit(s)

If dewatering activities are anticipated, a notarized City dewatering affidavit shall be filed at City's building department when submitting a demolition or foundation permit along with any applicable dewatering permit from regulatory agencies such as the South Florida Water Management District or Broward County Department of Environmental Protection.

**Dewatering Notes (Applicable if dewatering activities are anticipated)**

- a) The applicant shall use Broward County's latest [Plate WM 2.1 - Future Conditions](#) for determining the average wet season ground water levels to evaluate if demolition or excavation/earthwork will require dewatering activities. The Plate WM 2.1 – Future Conditions average wet season ground water levels can be accessed through the following link: <http://bcgis.maps.arcgis.com/apps/View/index.html?appid=70c3f3ffc88748c28e432719ec2844c4>
- b) If dewatering activities are anticipated, a notarized City dewatering affidavit shall be filed at City's building department when submitting a demolition or foundation permit along with any applicable dewatering permit from regulatory agencies such as the South Florida Water Management District or Broward County Department of Environmental Protection.
- c) If dewatering is going to be needed, please submit a dewatering plan, so it can be reviewed by the City's stormwater and environmental groups.
- d) Dewatering activities will not be allowed without an approved dewatering affidavit, SWPPP, and dewatering permit from applicable regulatory agencies.

14. For Engineering General Advisory DRC Information, please visit our website at <https://www.fortlauderdale.gov/home/showdocument?id=30249>

15. Additional comments may be forthcoming at the DRC meeting and once additional/ revised information is provided on plans.



Case Number: R19009

**CASE COMMENTS:**

Please provide a response to the following:

1. The City has adopted Florida Friendly Landscaping requirements into our ULDR Section 47-21. This includes limited sod areas, native plant requirements, hydrozone planting requirements, street tree requirements, irrigation limitations, etc. Please see MuniCode for updated ordinance [https://www.municode.com/library/fl/fort\\_lauderdale/codes/unified\\_land\\_development\\_code?nodeId=UNLADERE\\_CH47UNLADERE\\_ARTIIIIDERE\\_S47-21LATRPRRE](https://www.municode.com/library/fl/fort_lauderdale/codes/unified_land_development_code?nodeId=UNLADERE_CH47UNLADERE_ARTIIIIDERE_S47-21LATRPRRE)
2. Sec. 47-21.12. - Landscape requirements for vehicular use areas.
  - a. Please address the requirements of VUA landscape.
3. The use of structural soil is required in paved sites to provide adequate soil volumes for tree roots under pavements, as per ULDR Section 47-21.13. CU Structural soil details and specifications can be obtained at <http://www.hort.cornell.edu/uhi/outreach/index.htm#soil> This is to be provided at a minimum of 8' radii of tree trunks, and is to be consistently illustrated and noted on landscape, site and civil plans.

The structural soil drain is required when percolation rates are less than 4" vertical clearance per hour. Provide documentation of report used to prove this calculation. The drain and connections are to be illustrated on civil plans.

- a. Demonstrate hashing on landscape, site and civil plans as to the extent of use of the CU Structural Soil.
4. Lighting fixtures with an overall height of more than ten (10) feet shall be located a minimum of fifteen (15) feet away from shade trees - as per ULDR Section 47-21.12. Confirm with civil, and life safety plans that utilities and site amenities are not causing conflicts with proposed landscaping. Where conflicts exist, shift the utility and/or site amenities.
5. Please provide a narrative of the scope of work for there appears to be landscape work at adjacent hangers.
6. Landscape work at adjacent hangers may require separate approvals.
  - a. Please verify each hanger building address.
7. Section 47-14.21.C.1.d. Dimensional requirements for GAA and AIP districts. Location of yards, setbacks and landscaping on all other GAA zoned land shall be governed by the Federal Aviation Administration and the city commission after review by the development review committee.
  - a. Please provide landscape requirements and approvals from FAA for landscape installation within and at the perimeter of the site (around the hanger, vehicle use area and fence line).



### GENERAL COMMENTS

The following comments are for informational purposes.  
Please consider the following prior to submittal for Building Permit:

5. A separate sub-permit application for Tree Removal - Relocation and General Landscaping for site are required at time of master permit submittal. Landscape issued permits may be required for each individual hanger where work is done.
6. Provide separate Plumbing sub permit application for irrigation. Irrigation plans are required at time of Building permit submittal. Plans are to be in compliance with ULDR 47-21.6.A.11 and 47-21.10.





**Case Number: R19009**

**CASE COMMENTS:**

Please provide a response to the following:

1. The business should be equipped with an intrusion alarm that features a battery and or cellular back up system.
2. All entry and exit doors should be solid, impact resistant or metal and should be equipped with tamper resistant locking systems or a secondary deadbolt lock system.
3. All glazing should be impact resistant.
4. Offices and sensitive areas should be access controlled.
5. The site should be equipped with secured key management system for aircraft and aircraft equipment secured storage.
6. A Closed Circuit TV system (CCTV) should be utilized covering interior hangar area, offices, sensitive storage areas, entry – exit points and parking areas.

**GENERAL COMMENTS**

It is highly recommended that the managing company make arrangements for private security during construction.

Please submit responses in writing prior to DRC sign off.



Case Number: R19009

**CASE COMMENTS:**

Please provide a response to the following:

1. Garbage, Recycling and Bulk Trash shall be provided.
2. Recycling reduces the amount of trash your business creates and it is the best way to reduce monthly waste disposal costs and improve your company's bottom line.
3. Solid Waste Services shall be provided by a Private Contractor licensed by the City.
4. Service Days shall be: No restriction for Commercial collection. Service may not occur earlier than 7:00 am or later than 10:00 pm within 250 feet of residential.
5. Solid Waste Collection shall be on private property container shall not be placed, stored or block the public street to perform service (large multifamily and commercial parcels).
6. Containers: must comply with 47-19.4
7. Dumpster enclosure: concrete pad, decorative block wall, gates hung independently, protective bollards, secondary pedestrian side entry, high strengthen apron and driveway approach, night light, hot water, hose bib, drain, low circulating ventilation for dampness, weep holes, landscaping, smooth surface walkway to accommodate wheeled containers.
8. Provide on the site plan a garbage truck turning radii for City review. Indicate how truck will circulate within property.
9. Submit a Solid Waste Management Plan on your letterhead containing name of project, address, DRC case number, number of units if applicable, and indicate whether it is Pre or Final DRC.
  - o This letter is to be approved and signed off by the Sustainability Division, and should be attached to your drawings. Please email an electronic copy to [smccutcheon@fortlauderdale.gov](mailto:smccutcheon@fortlauderdale.gov). Letter should include an analysis of the expected amounts of solid waste and recyclables that will be generated (if different from current capacity), and container requirements to meet proposed capacity.
  - o Community Inspections will reference this Solid Waste Plan for sanitation compliance issues at this location.

**GENERAL COMMENTS**

The following comments are for informational purposes.

Please consider the following prior to submittal for Final DRC:

1. None



Case Number: R19009

**CASE COMMENTS:**

1. Please show and give a brief description on how the site circulation functions.
2. Additional comments may be provided upon further review.
3. Signature required.

**GENERAL COMMENTS:**

Please address comments below where applicable.

1. Contact Benjamin Restrepo at 954-828-5216 or brestrepo@fortlauderdale.gov to set up an appointment for final plan approval.
2. The City's Transportation & Mobility Department encourages the use of sustainable materials such as permeable pavement and electric car charge stations and installation of multimodal facilities such as bicycle pump stations and bike lockers.
3. Please note that any work within the City's right-of-way will require an MOT approved by Transportation and Mobility and Engineering for permitting. Any full closures of roadways, alleys, or sidewalks that are over 72 hours will require a Revocable License Agreement (RLA) with the City of Fort Lauderdale.



Case Number: R19009

**CASE COMMENTS:**

Please provide a response to the following:




- 1) The applicant is strongly encouraged to contact neighbors adjacent to, as well as condominium and neighborhood associations located within three hundred feet (300') of the development site, to advise of this proposal (a listing of officially-recognized associations is provided on the City's website: [www.fortlauderdale.gov/neighbors/civic-associations](http://www.fortlauderdale.gov/neighbors/civic-associations) and a map of neighborhood associations may be found at: <http://gis.fortlauderdale.gov>). Please provide acknowledgement and/or documentation of any public outreach.
- 2) The site is designated Transportation on the City's Future Land Use Map. The proposed use is permitted in this designation. This is not a determination on consistency with Comprehensive Plan Goals, Objectives and Policies.
- 3) Verify that copy of plat is the most current recorded plat, including notes and amendments, for the proposed site. Provide documentation from the Broward County Planning Council verifying that the site does not require platting or replatting. If replatting or platting is not required, contact the Development Review Services Section of the Planning and Environmental Regulation Division of Broward County at (954) 357-6637 to ensure that proposed project is consistent with the latest recorded plat restriction.
- 4) Please contact Thuy (Twee) Turner, AICP, Broward County Planning and Development Division [tturner@broward.org](mailto:tturner@broward.org) or 954-357-6623 to ensure the proposed plat note language meets their standards before moving forward. Please provide staff with written response from the County.
- 5) Provide landscape requirements and approvals from FAA for landscape installation within and at the perimeter of the site (around the hanger, vehicle use area and the fence line). See landscape comments for more information.
- 6) Provide a point-by-point narrative which indicates the projects compliance with the requirements of ULDR Sec. 47-14.21, Dimensional Requirements for GAA and AIP districts so we can better understand how the FAA requirements for height and setbacks are being met.
- 7) Consider employing green building practices throughout the project including, but not limited to charging stations, tankless water heaters, rain collection systems, pervious pavers, bio-swales, Florida Friendly™ plant materials, solar panels and green roofs.
- 8) It is recommended the following pedestrian and bicycle-related comments be addressed:
  - a. Site plan design indicates pedestrian/vehicle conflict areas. Accommodate safe pedestrian access, in particular, to/from public sidewalks, vehicle parking areas and building entrances.
  - b. Please email Karen Warfel at [kwarfel@fortlauderdale.gov](mailto:kwarfel@fortlauderdale.gov) for more information on bicycle parking standards and to obtain a copy of the Association of Pedestrian and Bicycle Professionals [APBP] Bicycle Parking Guidelines and Broward County End-of-Trip Bicycle Facility Guide.




**GENERAL COMMENTS:**

- 9) If additional temporary construction/sales trailers are needed for this project, provide the details and location of the trailer on a separate site plan, to avoid additional review in the future. Verify details and location with the Building Representative.
- 10) An additional follow-up coordination meeting may be required to review project changes necessitated by the DRC comments. Prior to routing your plans for Pre-PZ and/or Final DRC sign-off, please schedule an appointment with the project planner, Tyler Laforme (954-828-5633) to review project revisions and/or to obtain a signature routing stamp. Please note applicant is responsible for obtaining signatures from all discipline members that had comments and may need to resolve comments through individual appointments if necessary.
- 11) For additional information regarding incorporation of wireless capabilities into the project in initial planning stages, please contact the applicable utility provider.
- 12) construction activity must comply with ULDR, Section 24-11, Construction sites. Contact Frank Rabinowitz, Structural Plans Examiner (954-828-5237) to obtain his signature on the final DRC plans.
- 13) Additional comments may be forthcoming at the DRC meeting. Please provide a written response to all DRC comments within 180 days.

# Legend

-  \*Subject Site
-  FTL Corp Limits
-  \*Approximate Location

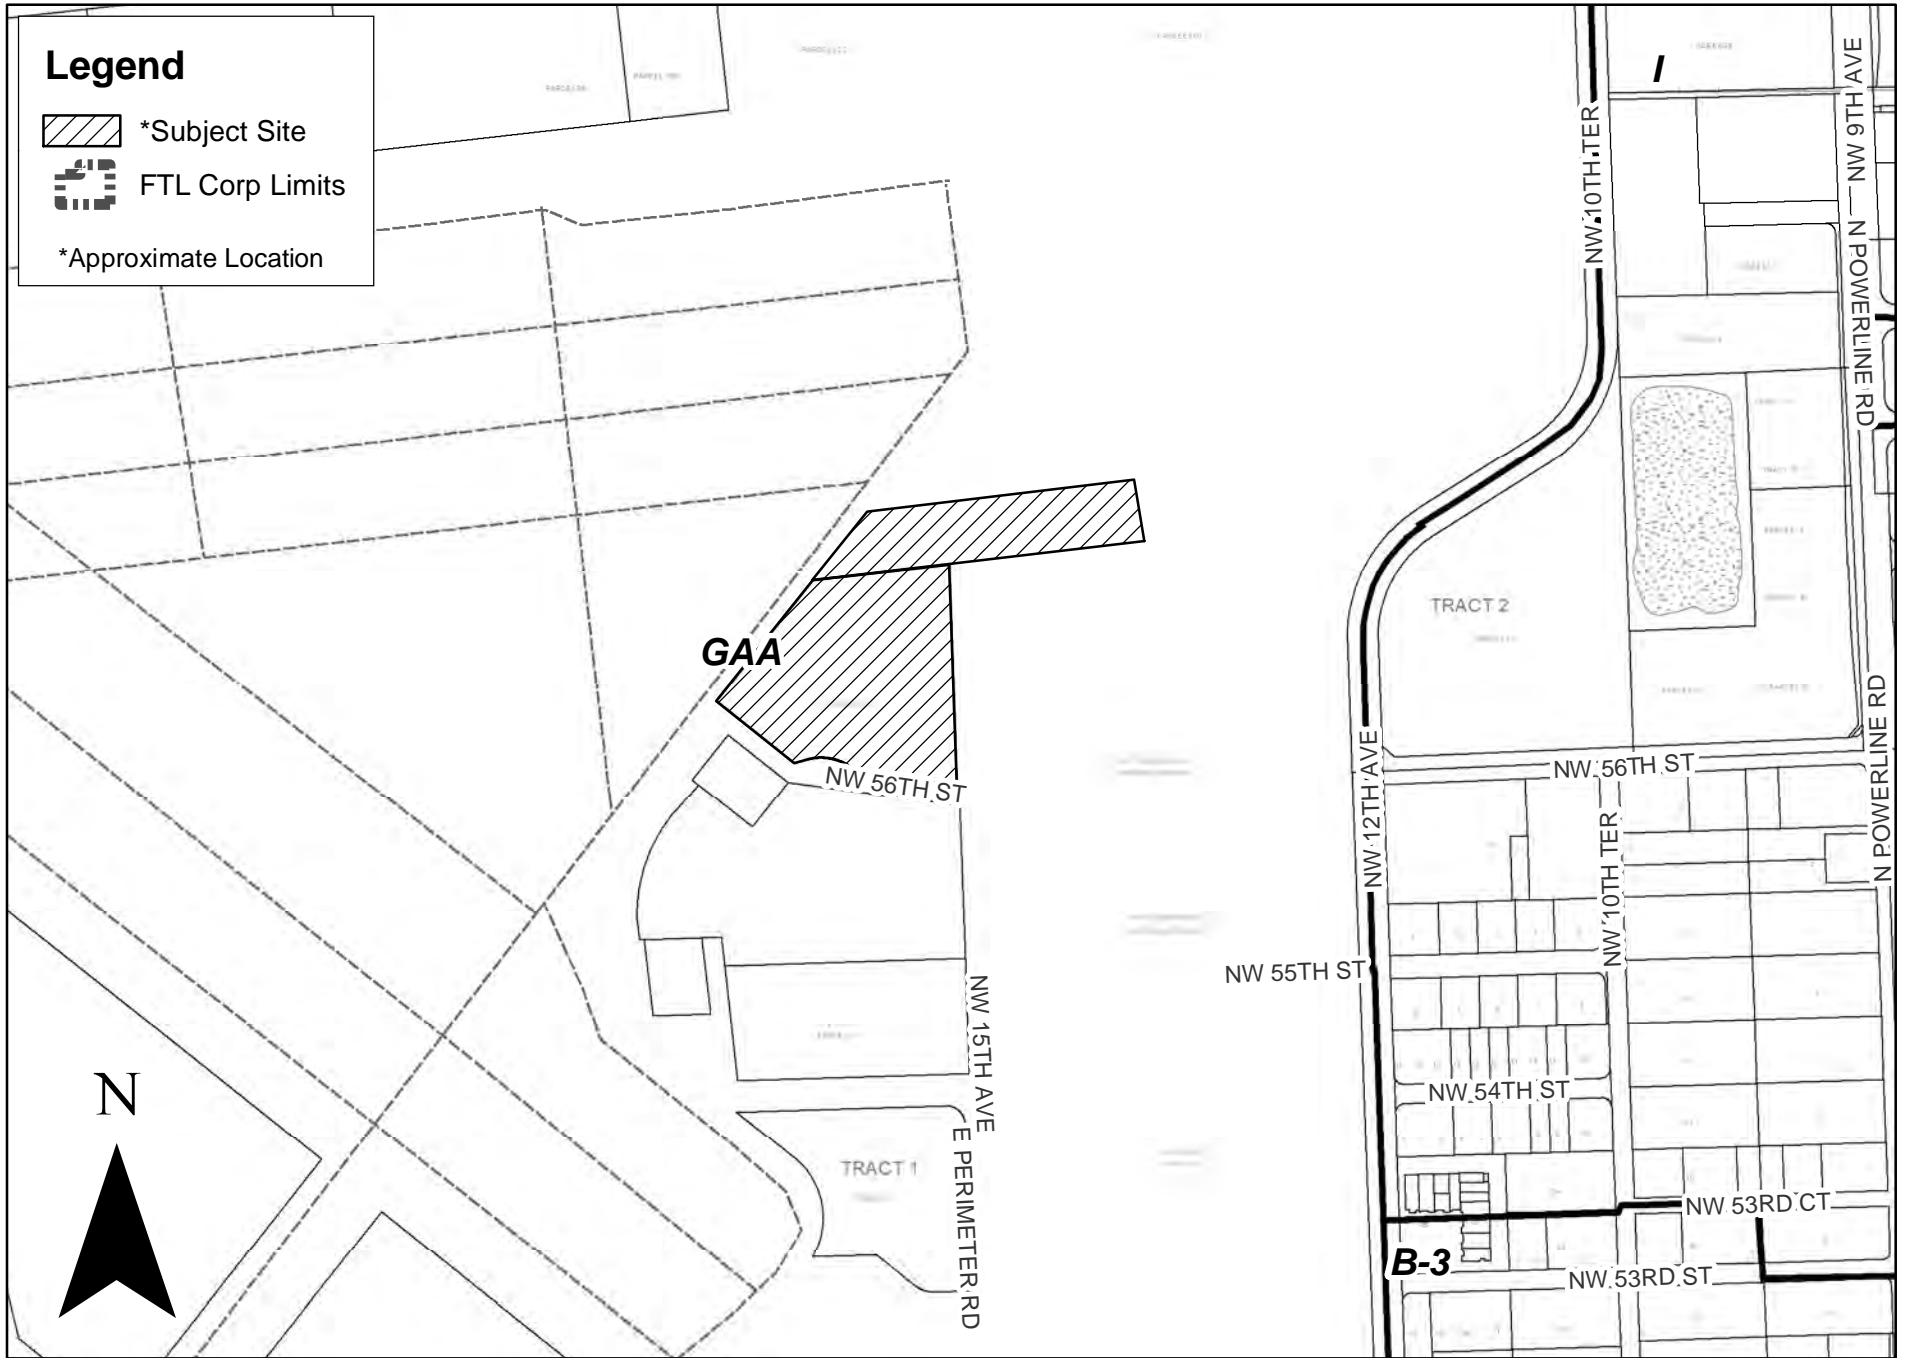

R19009

